


REVISIONS

ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	WAS ① 52-3/4 ② 50-3/4 ③ 18-1/4 ④ 2	19SEP98	

CONNECTING BAR
4 REQ'D

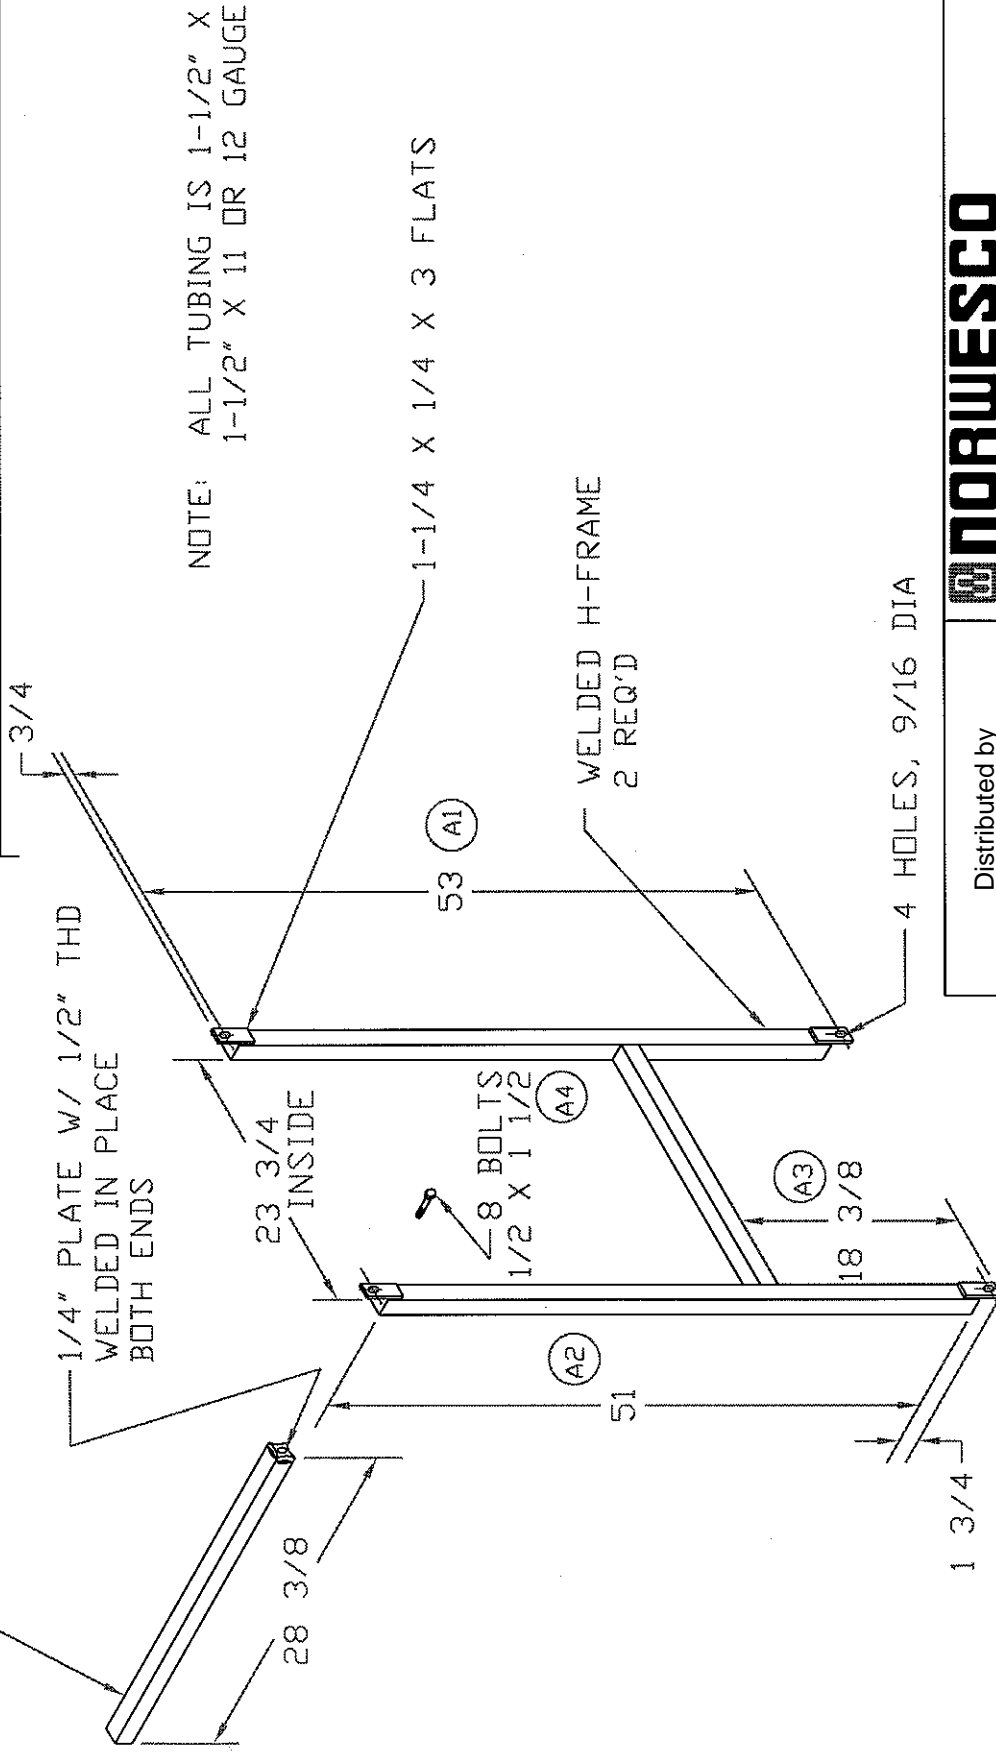

NOTE: ALL TUBING IS 1-1/2" X 1-1/2" X 11 OR 12 GAUGE

NORWESCO
ST. BONIFACIUS, MN

STEEL FRAME, 375 WATER TANK

Distributed by
AETNA PLASTICS
800-634-3074
www.aetnoplastics.com

SIZE A	FSCM NO.	DWG NO.	REV A
JTP 1AUG96			
SCALE 1/16	SHEET 2 OF 2		